

# 厦门赛特勒磁电有限公司/ Xiamen Zettler Magnetics Co., Ltd.

中国厦门市湖里大道48-50号银丰工业大厦7楼(7/F, Yin Feng Building, No.48-50 Hui Road, Huli District, Xiamen, China, 361006)

电话 (TEL) : +86 592 2650988

传真 (FAX) : +86 592 2650900

## 承认书/ Specification for approval

客户名称/ Customer: \_\_\_\_\_

产品类型/Description: \_\_\_\_\_ Transformer

产品品名/ZETTLER p/n \_\_\_\_\_ AHI05010

客户名/Customer p/n: \_\_\_\_\_

版本标识/ Revision: \_\_\_\_\_ A0

页码标识/Page No. : \_\_\_\_\_ page 1 of 3

编制日期/Draft date : \_\_\_\_\_ 2013-5-20

| 编制/Drafted | 审核/Checked | 批准/Approved |
|------------|------------|-------------|
| Linda      | David      | Chenmin     |

客户承认/Approved by Customer : \_\_\_\_\_

友情提示:请在签字确认后,按封面的传真号码回传给赛特勒磁电有限公司.如无回传,则视为默认,后续的相关订单将以按本承认书的规定为技术要求.

Friendly Reminder: Please help to sign this Spec when approve, and fax to ZETTLERmagnetics. Or else, we will consider you have accepted it and make future order based on this Spec.



|         |         |                    |             |
|---------|---------|--------------------|-------------|
|         |         |                    |             |
|         |         |                    |             |
|         |         |                    |             |
|         |         |                    |             |
|         |         |                    |             |
|         |         |                    |             |
| 版本/Rev. | 日期/Date | 变更内容描述/Description | 承认/Approved |

承认书 / SPECIFICATIONS FOR APPROVAL

CUSTOMER:

ZETTLER P/N:AH105010

Customer p/n:



DATE:2013-5-20

VER.:A0


PAGE No.:page 2 of 3

1.OUTLINE DRAWING(外形图):


UNIT(单位): mm

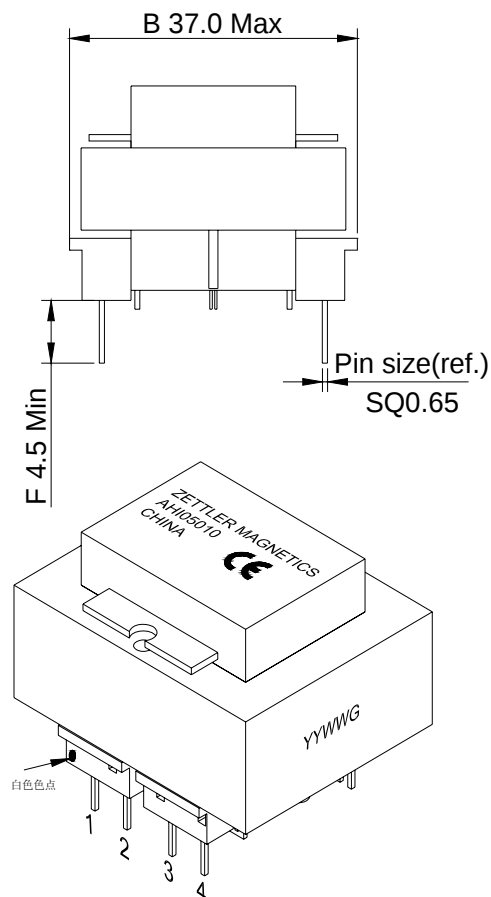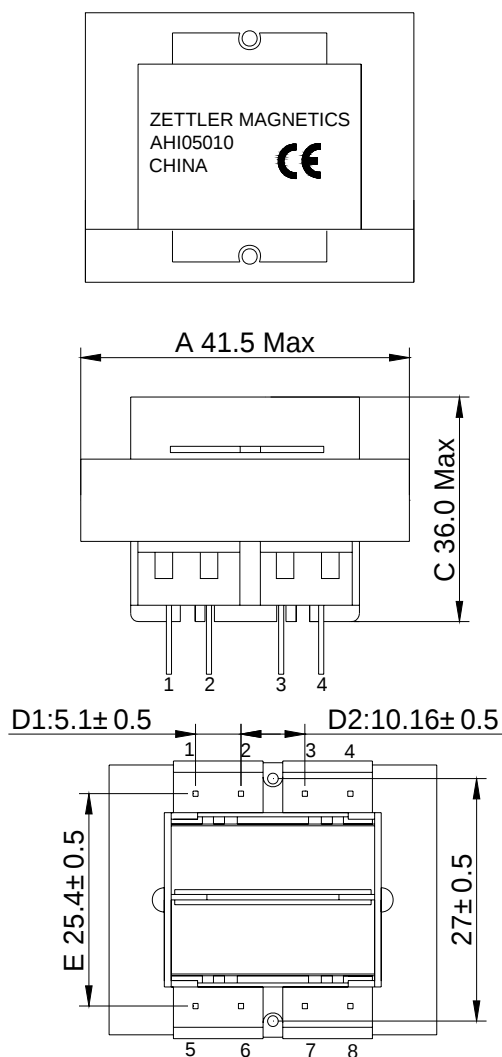

2.SCHEMATIC(原理图):

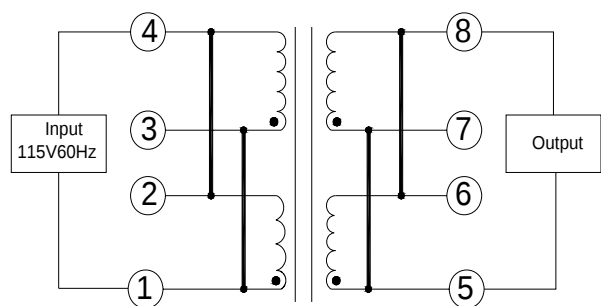

Parallel Circuit

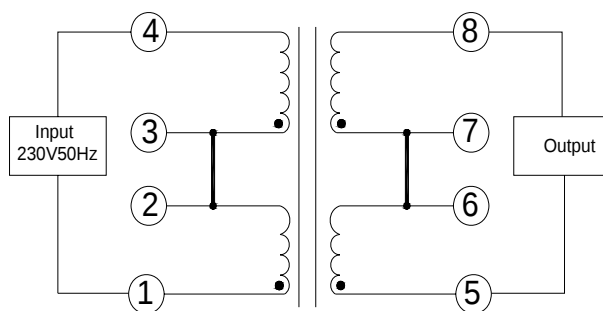

Series Circuit

3.ELECTRICAL SPECIFICATION(电气特性测试):

| ITEM<br>项目        | RESISTANCE<br>电阻 (Ω) |           | EXCITATION CURRENT<br>空载电流 (mA) | OUTPUT VOLTAGE<br>输出电压 (VAC) |          |                         |           | INSULATION<br>RESISTANCE<br>绝缘阻抗 | HI-POT VOLTAGE<br>耐压    |
|-------------------|----------------------|-----------|---------------------------------|------------------------------|----------|-------------------------|-----------|----------------------------------|-------------------------|
| CONDITION<br>测试条件 | (25° C)              |           | INPUT:115V 60Hz                 | PAR.<br>Input:115V 60Hz      |          | SER.<br>Input:230V 50Hz |           | DC 500V/1min                     | 1mA/1min                |
| TERMINAL<br>端子    | 1--2                 | 5--6      | 1, 3--2, 4                      | PAR. OUTPUT VOLTAGE          |          | SER. OUTPUT VOLTAGE     |           | P--P                             | P--S<br>P, S--C<br>S--S |
|                   | 3--4                 | 7--8      |                                 | 0mA                          | 1.0A     | 0mA                     | 0.5A      | P--S                             |                         |
| STANDARD<br>要求    | 538 ± 15%            | 1.2 ± 15% | 45 Max                          | 6.6 ± 5%                     | 5.0 ± 5% | 13.2 ± 5%               | 10.0 ± 5% | 100MΩ MIN                        | 4.0KV                   |